

ELEV, ALT & HGT IN FEET  
DIST IN NM  
BRG ARE MAG  
VAR 21°W (2007)

NOTE

1. Power station 5 NM south of aerodrome with 2 smoke stacks at 300' AGL, 4 cooling towers 200' AGL, steel towers 150' AGL with conductors strung between them.
2. Two major power lines east of aerodrome.
3. ACFT must adhere to RWYs and TWYs and park in parking area.

NEWCASTLE


NDB 415.0

NC =: --

27°46'04.40"S

029°58'34.44"E

4057'

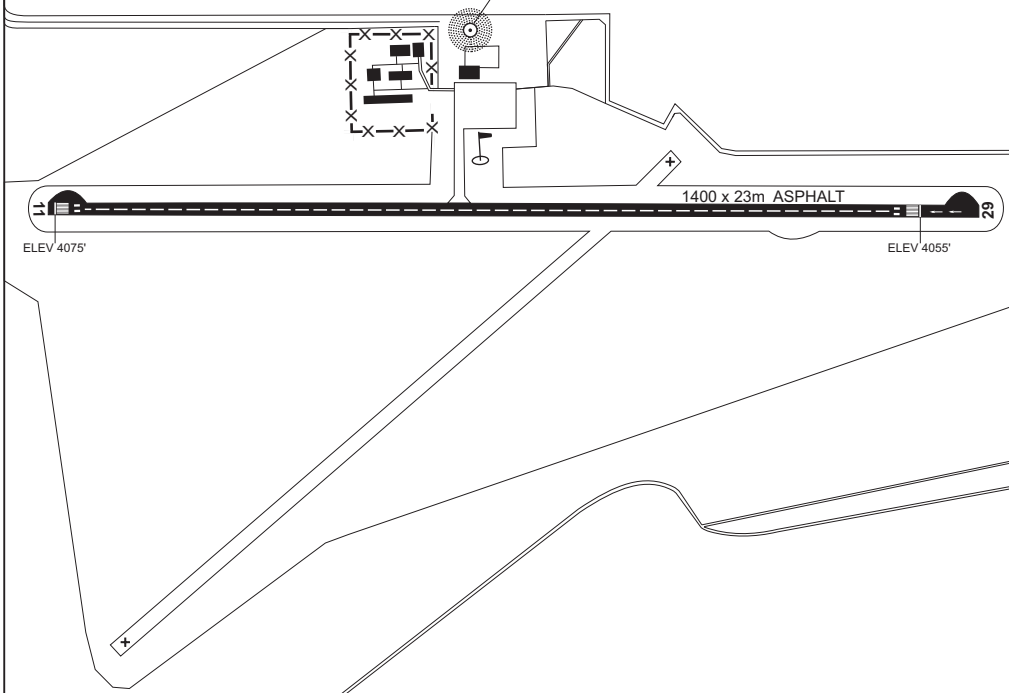

RWY LIGHTING					
RWY	APCH	PAPI	THR LGT	RWY LGT	RWY END
11	NIL	3° L	Green	REDL	RED
29	NIL	3° L	Green	REDL	RED

OTHER: Remote RWY Lights:  
1. 7 clicks on FREQ 124.8 MHZ during 5 second period switches lights ON.  
2. RWY lights switches OFF after 20 minutes.

NOT TO SCALE

PHYSICAL CHARACTERISTICS

RWY	DIRECTION	THR COORDINATES	THR ELEVATION	DIMENSIONS (m)	TORA (m)	TODA (m)	ASDA (m)	LDA (m)	SLOPE	BEARING STRENGTH	SURFACE
11	091°(T)	27°46'13.64"S 029°58'09.37"E	4075'	1400 x 23	1400	1400	1500	1400	-0.43%	LCN 18	ASPH
29	271°(T)	27°46'14.31"S 029°59'00.51"E	4055'		1500	1500	1500	1400	+0.43%		

CHANGE: New Format/New Position NDB NC